


External Hex 04.0mm 12°/24° Co-Axis® Implants (Tapered) Reduced Platform


- Drill Sequence Page 1 of 2

Tapered (IBR12d / MSc-IBR12d Co-Axis)


Soft Bone

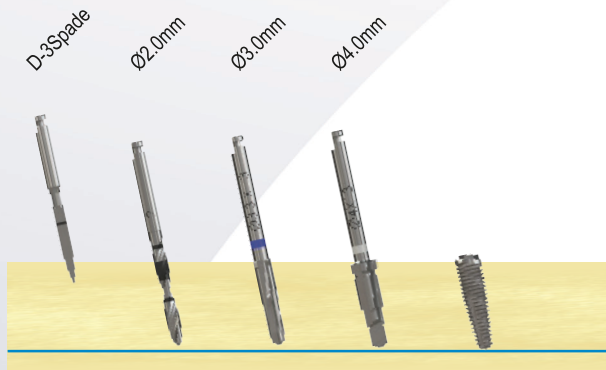

Medium Bone

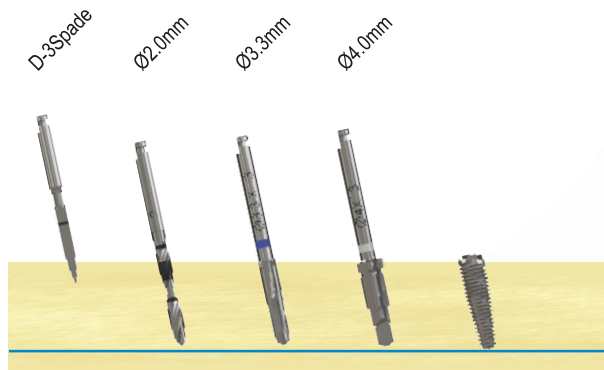

Dense Bone

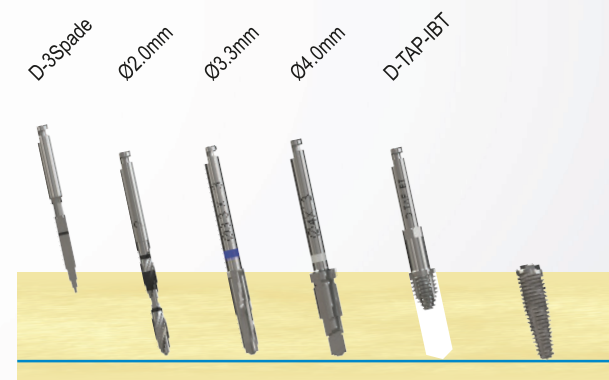


NOTE: Site preparation Sequence recommended by Southern Implants does not replace the judgement and experience of the surgeon.
(Illustration is for 13mm implants)

External Hex 04.0mm 12°/24° Co-Axis® Implants (Tapered) Reduced Platform


- Drill Sequence Page 2 of 2

Tapered (IBR24d / MSc-IBR24d Co-Axis)


Soft Bone

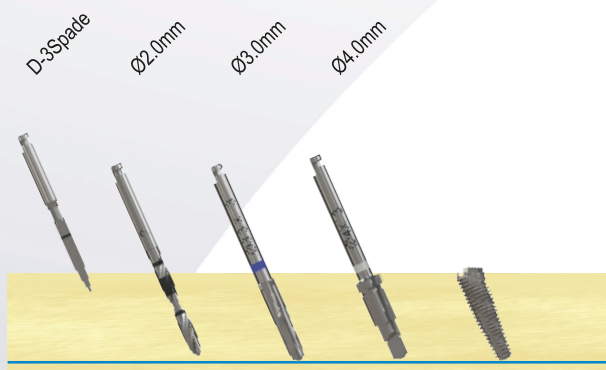

Medium Bone

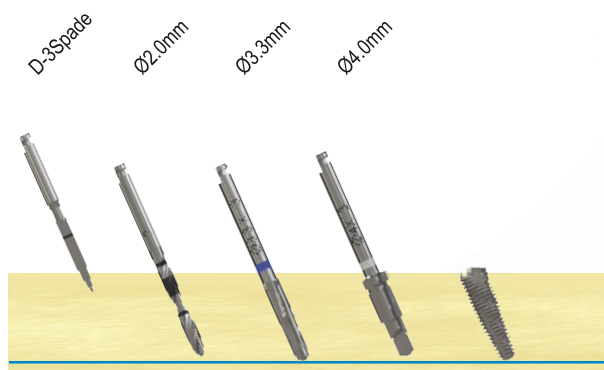

Dense Bone

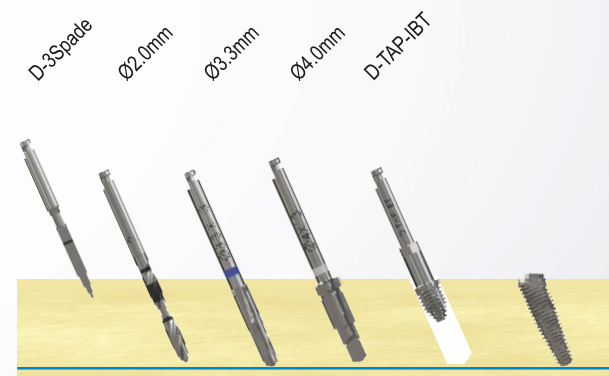

NOTE: Site preparation Sequence recommended by Southern Implants does not replace the judgement and experience of the surgeon.
(Illustration is for 13mm implants)